

HYGROTHERMAL SNAPSHOT

Exterior Mineral Wool Insulation on Framed Wall



Seattle, Washington | 47.26°N 122.18°W | Elev. 400 ft | -8 UTC

RATING


Fail



ASSEMBLY COMPONENTS			PARAMETERS		CLIMATE NORMALS	
1	Fiber Cement, Painted	0.31 in	Test Duration	2 Yrs	Temp. Daily Max / Min	60.2°F / 45°F
2	Rainscreen Air Space	0.75 in	Interior Moisture	Low	RH Daily Max / Min	85% / 62%
3	Mineral Wool Board	1.5 in	Interior Temperature	69.8°F ± 1.8°F	Rainfall	37.5 in
4	Housewrap WRB	0.008 in	Interior Humidity	45% ± 15%	Snowfall	6.8 in
5	OSB Sheathing	0.492 in	Orientation / Inclination	N / 90°	Wind Speed	8.0 mph
6	Fiberglass Batt Insulation	5.5 in	Exterior Coating	-	Wind Direction	220°
7	Polyethylene VR	0.039 in	Interior Coating	-	Station Air Pressure	29.5 in
8	Interior Gypsum Board	0.492 in	Rain Exposure / Deposition ¹	1 / 0.5	Heating Degree Days (65 F)	4,697
9	Interior Paint & Primer	0.003 in	Rain Penetration ¹ (▶)	0.5%, 0.5%	Cooling Degree Days (65 F)	189
			Rainscreen / ACH	Yes / 120	Modeled Climate Data	WUFI

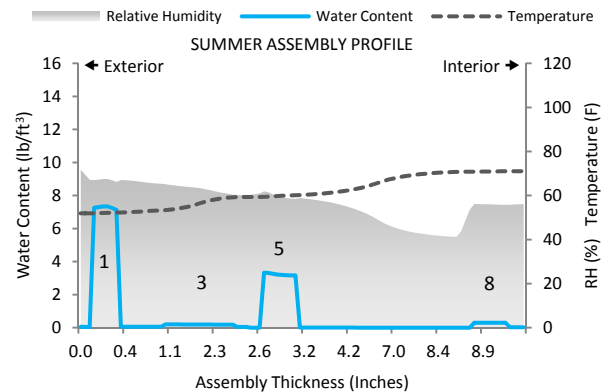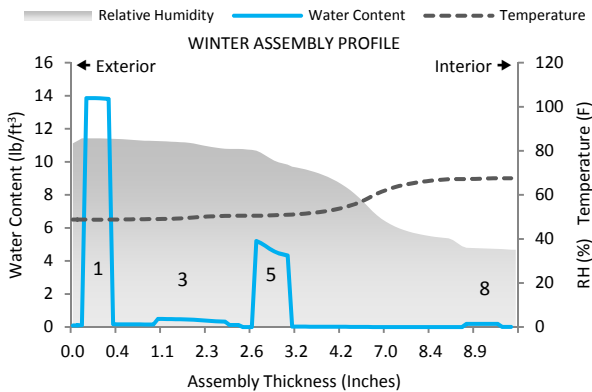

MOLD AND CORROSION RISKS AT PREDICTED RH AND SURFACE TEMPERATURES (YEAR 2)

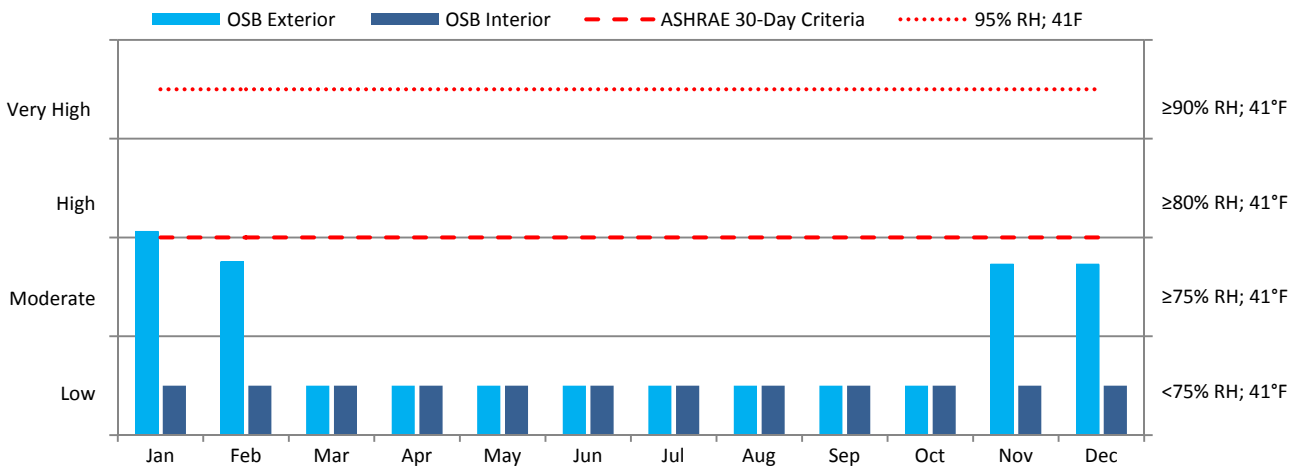

PERFORMANCE RATINGS

Ratings are based on ASHRAE Standard 160¹. Resistant materials are evaluated based on hourly 30-day running averages at ≥95% RH, 41°F.

P = Pass; Criteria met

C = Conditional; Criteria compliance is uncertain

F = Fail; Criteria not met for a 30-day running average

CF = Critical Fail; Criteria not met at multiple 30-day running averages

ABOUT THIS REPORT

These findings are offered for informational purposes only and are not intended as a comprehensive hygrothermal analysis. Design considerations should not rely on this report as the sole means for predicting assembly performance. Uncertainties and limitations inherent to hygrothermal modeling apply to these findings². For more information, visit our website at www.built-environments.com.

1. ASHRAE Standard 160: Criteria for Moisture-Control Design Analysis in Buildings.

2. ASTM MNL 18: Moisture Control in Buildings.